


TABELA REGULACYJNA

Ciepłownia Jawor ul. Kuziennicza 4

T_{zew} [°C]	T_z [°C]	T_p [°C]	V [m ³ /h]
-20	120	57	246
-19	118	56	245
-18	116	55	244
-17	114	54	244
-16	111	53	243
-15	109	52	243
-14	107	51	242
-13	105	51	241
-12	103	50	241
-11	100	49	240
-10	98	48	240
-9	96	47	239
-8	94	46	239
-7	91	45	239
-6	89	44	238
-5	87	43	238
-4	85	43	238
-3	82	42	238
-2	80	41	238
-1	78	40	238
0	75	39	239
1	73	39	239
2	70	38	240
3	68	37	242
4	66	36	243
5	65	37	242
6	65	38	240
7	65	38	237
8	65	39	234
9	65	40	231
10	65	40	228
11	65	40	224
12	65	40	220

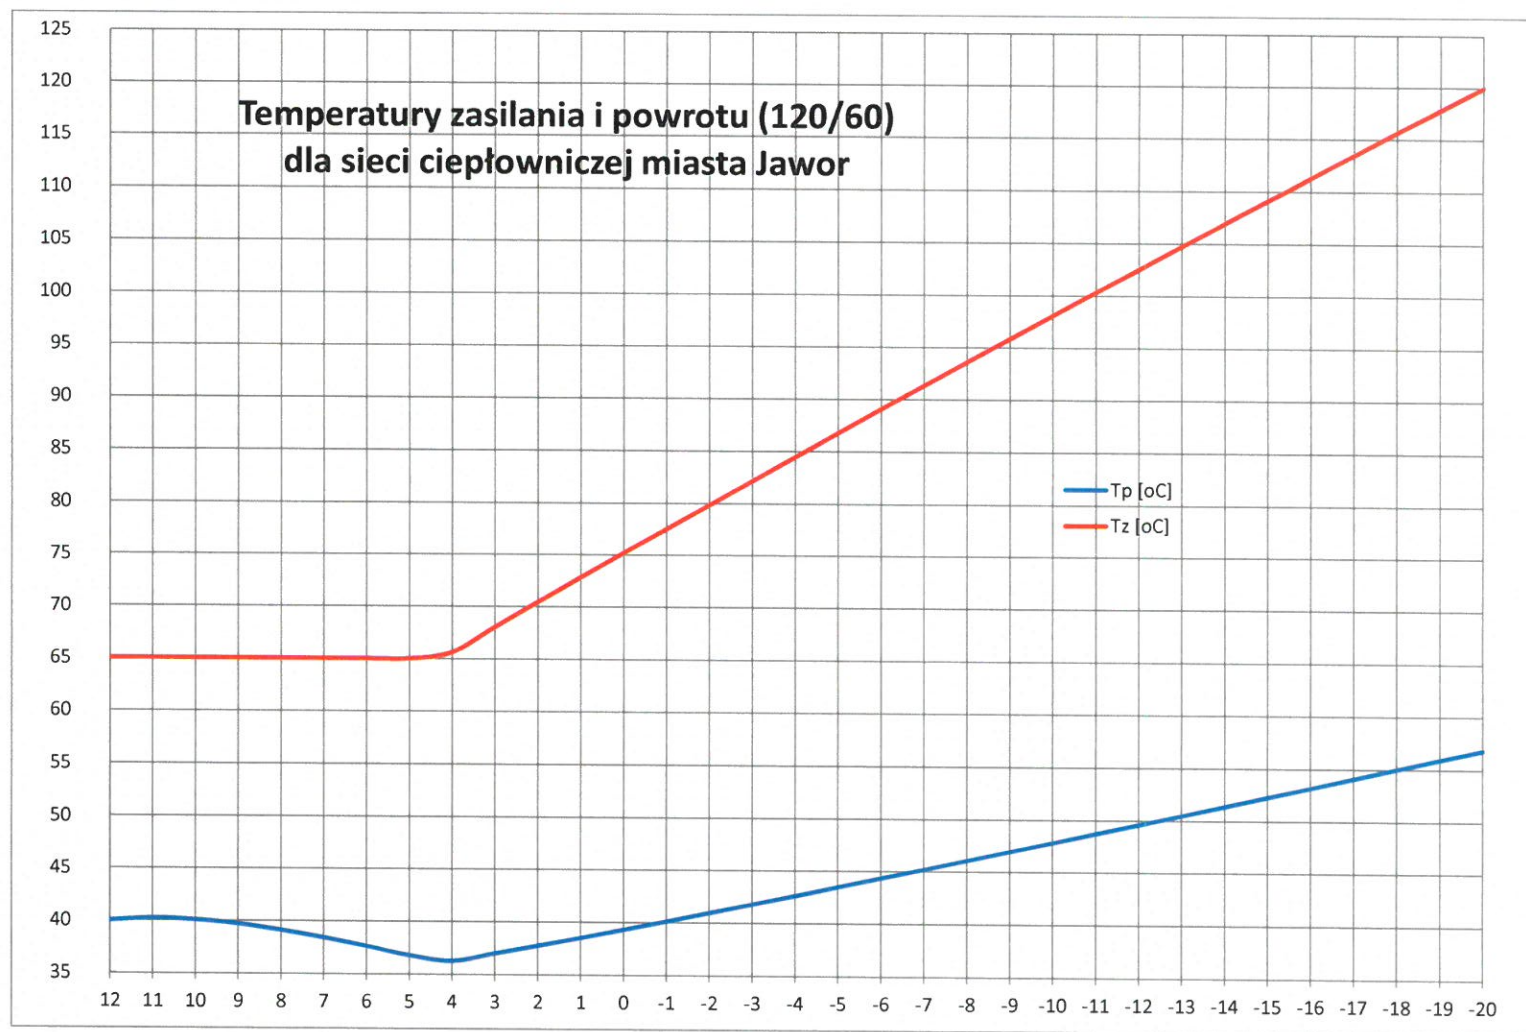

Jawor, dnia 15.11.2021 r.

Opracował:

CIEPŁO - JAWOR Sp. z o.o.
 DYREKTOR
[Signature]
 Tomasz Sowa

CIEPŁO JAWOR Sp. z o.o.
 PREZES ZARZĄDU

[Signature]
 Tomasz Papasiuk
 Zatwierdził: