


ՀԱՐՈՑԱՆԱԿ 11 ԸՆԴՈՒՄ 3:ԱԾԿ.

6. System tree

OAC-1-1

MULTI V S(ARUN040LSS0 :)

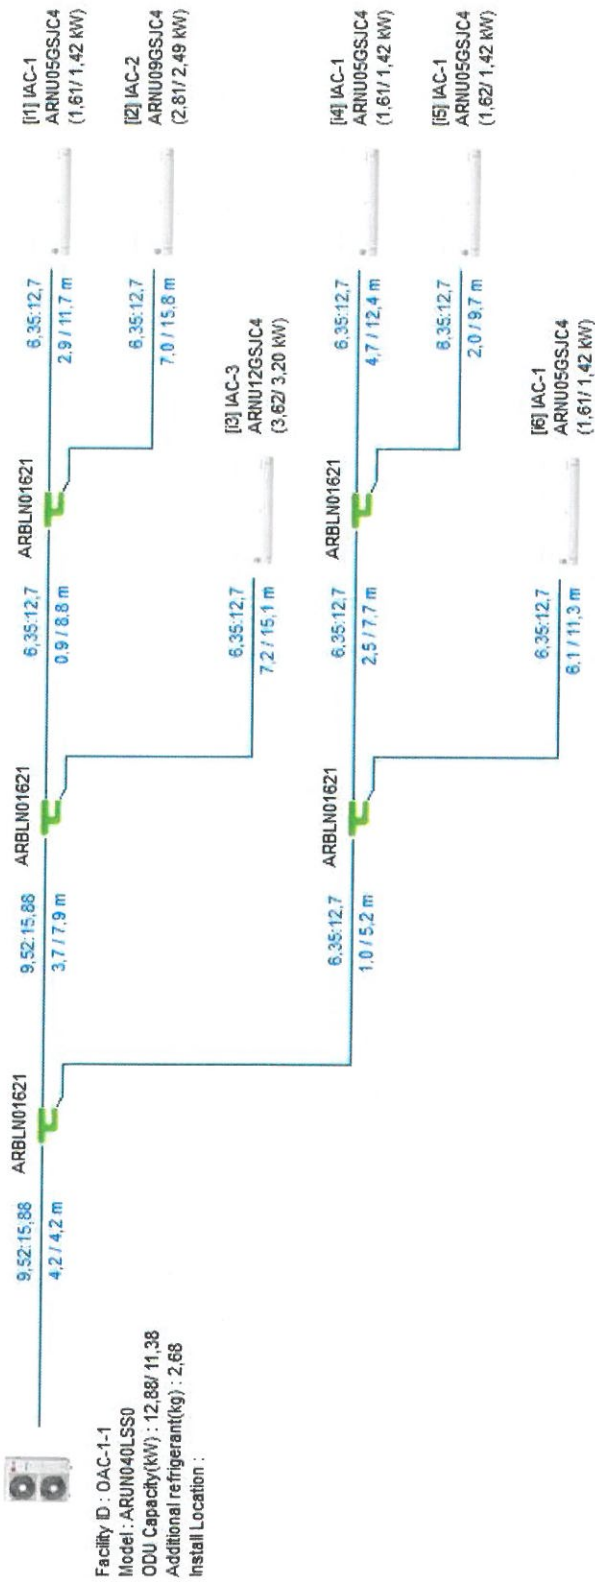

6. System tree

OAC-2-1

Standard Inverter(AUUW368D2 :)



Facility ID : OAC-2-1
Model : AUUW368D2
ODU Capacity(kW) : 10,04/ 7,42
Additional refrigerant(kg) : 0,19
Install Location :

6. System tree

OAC-2-2

Standard Inverter(AUUW368D2 :)



Facility ID : OAC-2-2
Model : AUUW368D2
ODU Capacity(kW) : 10,13/7,44
Additional refrigerant(kg) : 0,03
Install Location :