


Samoczynne wyłączenie w układzie TN-S

Samoczynne wyłączenie w układzie TN-S

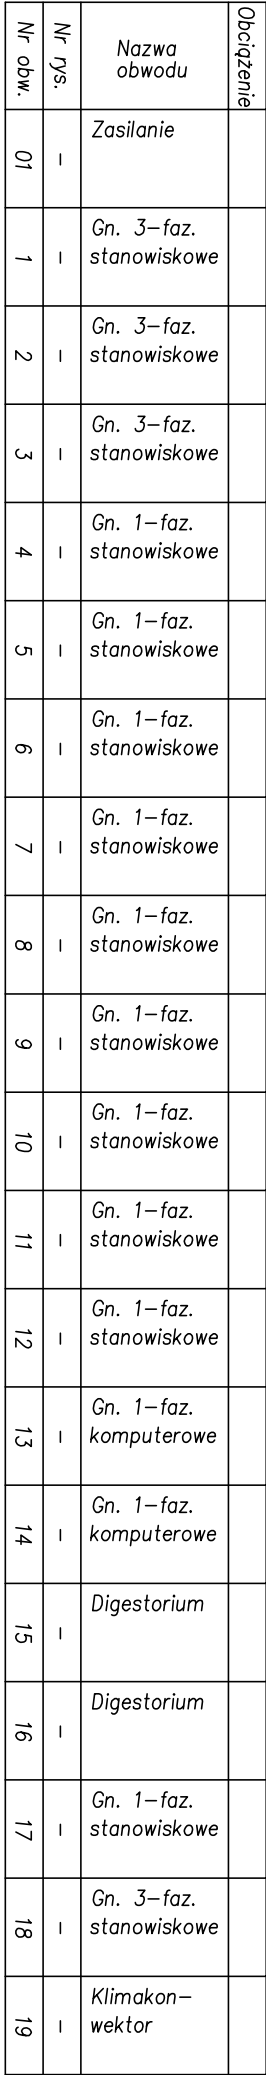

Obwody niewykorzystane stanowią rezerwę

Sxxxx	Rxxx	Moc	Kabel
S463	R42-8	10kW	XLPE 5x16
S486	R42-1	17kW	XLPE 5x35
S464	R42-8	11kW	XLPE 5x16
S366	R32-7	15kW	XLPE 5x25
S367	R32-7	22kW	XLPE 5x25
S3130	R33-6	19kW	XLPE 5x25
S3129	R33-7	19kW	XLPE 5x25
S470	R42-9	13kW	XLPE 5x16
S332	R31-11	24kW	XLPE 5x25
S1138	R11-11	15kW	XLPE 5x16
S1148	R12-11	7kW	XLPE 5x16
S156	R11-10	19kW	XLPE 5x16
S162	R11-13	11kW	XLPE 5x16
S163	R11-13	11kW	XLPE 5x16
S167	R11-12	12kW	XLPE 5x16
S2104	R22-11	24kW	XLPE 5x25
S2106	R22-11	10kW	XLPE 5x25
S296	R22-10	12kW	XLPE 5x16
S295	R22-10	13kW	XLPE 5x16
S294	R22-9	14kW	XLPE 5x25
S533	R53-7	15kW	XLPE 5x25
S532	R53-7	16kW	XLPE 5x25